



**DEPARTMENT OF REGULATORY AND ECONOMIC RESOURCES (RER)
BOARD AND CODE ADMINISTRATION DIVISION
NOTICE OF ACCEPTANCE (NOA)**

**MIAMI-DADE COUNTY
PRODUCT CONTROL SECTION**
11805 SW 26 Street, Room 208
Miami, Florida 33175-2474
T (786) 315-2590 F (786) 315-2599
www.miamidade.gov/economy

**SIW Impact Windows LLC
975 S. Congress Ave. #102
Delray Beach, FL 33445**

SCOPE:

This NOA is being issued under the applicable rules and regulations governing the use of construction materials. The documentation submitted has been reviewed and accepted by Miami-Dade County RER-Product Control Section to be used in Miami Dade County and other areas where allowed by the Authority Having Jurisdiction (AHJ).

This NOA shall not be valid after the expiration date stated below. The Miami-Dade County Product Control Section (In Miami Dade County) and/or the AHJ (in areas other than Miami Dade County) reserve the right to have this product or material tested for quality assurance purposes. If this product or material fails to perform in the accepted manner, the manufacturer will incur the expense of such testing and the AHJ may immediately revoke, modify, or suspend the use of such product or material within their jurisdiction. RER reserves the right to revoke this acceptance, if it is determined by Miami-Dade County Product Control Section that this product or material fails to meet the requirements of the applicable building code.

This product is approved as described herein, and has been designed to comply with the Florida Building Code, including the High Velocity Hurricane Zone.

DESCRIPTION: Series S-2000-16-2 Aluminum and Glass Sectional Garage Door up to 16'-2" Wide

APPROVAL DOCUMENT: Drawing No. 17-04, titled "S-2000 (16-2) Alum/Glass Sectional Garage Door (L.M.I.), sheets 1 through 7 of 7, dated 02/09/2017, with revision A dated 03/23/2017, prepared by the Al-Farooq Corporation, signed and sealed by Javad Ahmad, P.E., bearing the Miami-Dade County Product Control approval stamp with the Notice of Acceptance number and approval date by the Miami-Dade County Product Control Section.

MISSILE IMPACT RATING: Large and Small Missile Impact Resistant

LABELING: A permanent label with the manufacturer's name or logo, manufacturing address, model number, the positive and negative design pressure rating, indicate impact rated if applicable, installation instruction drawing reference number, approval number (NOA), the applicable test standards, and the statement reading 'Miami-Dade County Product Control Approved' is to be located on the door's side track, bottom angle, or inner surface of a panel.

RENEWAL of this NOA shall be considered after a renewal application has been filed and there has been no change in the applicable building code negatively affecting the performance of this product.

TERMINATION of this NOA will occur after the expiration date or if there has been a revision or change in the materials, use, and/or manufacture of the product or process. Misuse of this NOA as an endorsement of any product, for sales, advertising or any other purposes shall automatically terminate this NOA. Failure to comply with any section of this NOA shall be cause for termination and removal of NOA.

LIMITATION: Roll-up mechanism is not part of this approval.

ADVERTISEMENT: The NOA number preceded by the words Miami-Dade County, Florida, and followed by the expiration date may be displayed in advertising literature. If any portion of the NOA is displayed, then it shall be done in its entirety.

INSPECTION: A copy of this entire NOA shall be provided to the user by the manufacturer or its distributors and shall be available for inspection at the job site at the request of the Building Official.

This NOA consists of this page 1 and evidence page E-1, as well as approval document mentioned above.

The submitted documentation was reviewed by **Carlos M. Utrera, P.E.**



Handwritten signature and date: 04/13/2017

**NOA No. 17-0215.10
Expiration Date: April 20, 2022
Approval Date: April 20, 2017
Page 1**

NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

A. DRAWINGS

1. Drawing No. **17-04**, titled "S-2000 (16-2) Alum/Glass Sectional Garage Door (L.M.I.), sheets 1 through 7 of 7, dated 02/09/2017, with revision A dated 03/23/2017, prepared by the Al-Farooq Corporation, signed and sealed by Javad Ahmad, P.E.

B. TESTS

1. Addendum letter to Test Report No. **BT-SIW-16-006**, dated 03/21/2017, signed and sealed by Constantin Bortes, P.E.
2. Test reports on
 - 1) Air Infiltration Test, per FBC, TAS 202-94
 - 2) Uniform Static Air Pressure Test, Loading per FBC TAS 202-94
 - 3) Large Missile Impact Test per FBC, TAS 201-94
 - 4) Cyclic Wind Pressure Loading per FBC, TAS 203-94
 - 5) Forced Entry Test, per FBC, TAS 202-94

along with marked-up drawings and installation diagram of a Series S-2000 Aluminum Glass Garage Door 12'-0" (Specimen #2, 3 and 4), prepared by Blackwater Testing Inc, Test Report No. **BT-SIW-16-006**, dated 01/18/2017, signed and sealed by Constantin Bortes, P.E.

C. CALCULATIONS

1. Anchor calculations prepared by Al-Farooq Corporation, dated 01/24/2017, signed and sealed by Javad Ahmad, P.E.

D. QUALITY ASSURANCE

1. Miami-Dade Department of Regulatory and Economic Resources (RER)

E. MATERIAL CERTIFICATIONS


1. None.

F. STATEMENTS


1. Statement letter of code conformance to the 5th edition (2014) FBC and of no financial interest issued by Al-Farooq Corporation, dated 01/24/2017, signed and sealed by Javad Ahmad, P.E.




Carlos M. Utrera, P.E.
Product Control Examiner
NOA No. 17-0215.10
Expiration Date: April 20, 2022
Approval Date: April 20, 2017

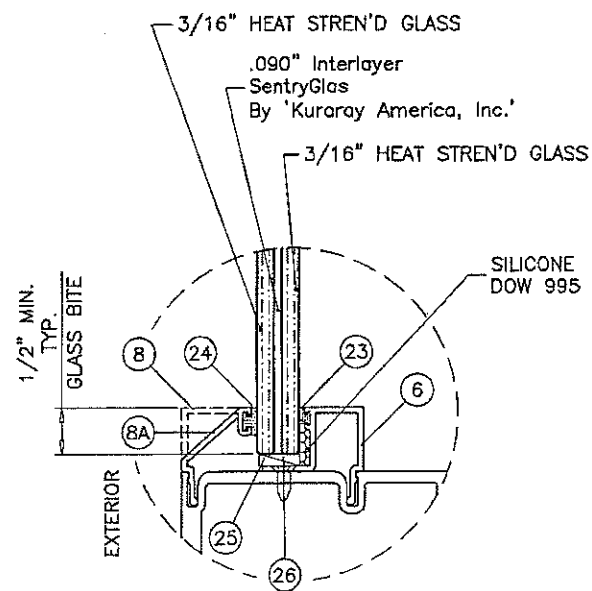

GLASS TYPE 'G1'
7/16" OVERALL LAM. GLASS

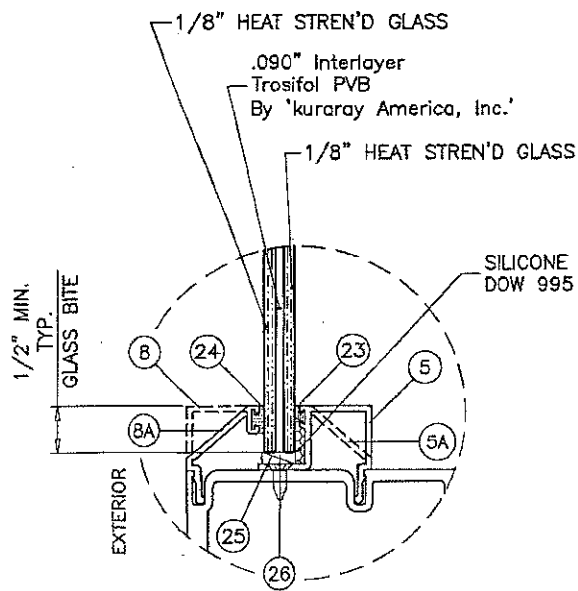

GLASS TYPE 'G2'
5/16" OVERALL LAM. GLASS

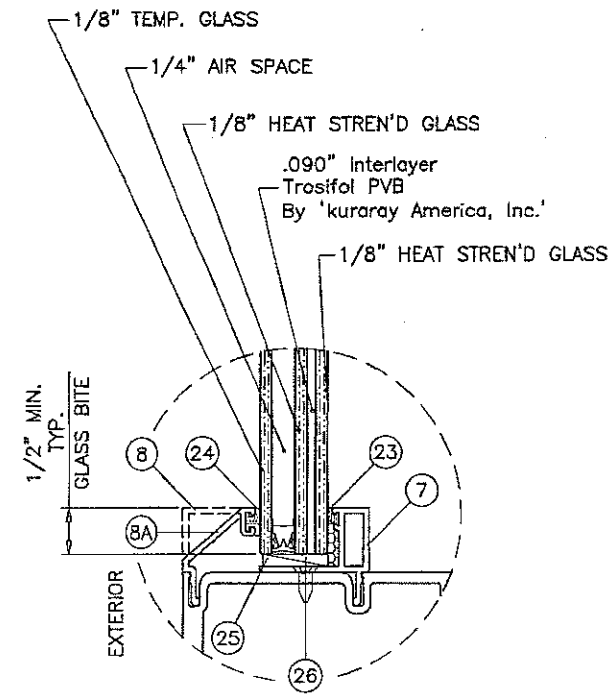

GLASS TYPE 'G3'
11/16" OVERALL INSUL. LAM. GLASS

GLAZING OPTIONS

NOTE:
GLASS CAPACITIES ARE
BASED ON ASTM E1300-09 (3 SEC. GUSTS)
AND FLORIDA BUILDING COMMISSION
DECLARATORY STATEMENT DCA05-DEC-219

THESE DOORS ARE RATED FOR LARGE & SMALL MISSILE IMPACT.
SHUTTERS ARE NOT REQUIRED.

SERIES 2000 (16-2)
ALUMINUM/GLASS SECTIONAL GARAGE DOOR

THIS PRODUCT HAS BEEN DESIGNED AND TESTED TO COMPLY WITH THE REQUIREMENTS OF THE 2014 (5TH EDITION) FLORIDA BUILDING CODE INCLUDING HIGH VELOCITY HURRICANE ZONE (HVHZ).

WOOD BUCKS & BUCK FASTENERS BY OTHERS, MUST BE DESIGNED AND INSTALLED ADEQUATELY TO TRANSFER APPLIED PRODUCT LOADS TO THE BUILDING STRUCTURE.

ANCHORS SHALL BE CORROSION RESISTANT, SPACED AS SHOWN ON DETAILS AND INSTALLED PER MANUF'S INSTRUCTIONS. SPECIFIED EMBEDMENT TO BASE MATERIAL SHALL BE BEYOND WALL DRESSING OR STUCCO.

A LOAD DURATION INCREASE IS USED IN DESIGN OF ANCHORS INTO WOOD ONLY.

ALL SHIMS TO BE HIGH IMPACT, NON-METALLIC AND NON-COMPRESSIBLE.

MATERIALS INCLUDING BUT NOT LIMITED TO STEEL/METAL SCREWS, THAT COME INTO CONTACT WITH OTHER DISSIMILAR MATERIALS SHALL MEET THE REQUIREMENTS OF THE 2014 FLORIDA BUILDING CODE & ADOPTED STANDARDS.

THIS PRODUCT APPROVAL IS GENERIC AND DOES NOT PROVIDE INFORMATION FOR A SITE SPECIFIC PROJECT, i.e. LIFE SAFETY OF THIS PRODUCT, ADEQUACY OF STRUCTURE RECEIVING THIS PRODUCT AND SEALING AROUND OPENING FOR WATER INFILTRATION RESISTANCE ETC.

CONDITIONS NOT SHOWN IN THIS DRAWING ARE TO BE ANALYZED SEPARATELY, AND TO BE REVIEWED BY BUILDING OFFICIAL.


MANUFACTURER'S LABEL SHALL BE LOCATED ON A READILY VISIBLE LOCATION IN ACCORDANCE WITH SECTION 1710.8.3 OF FLORIDA BUILDING CODE. LABELING TO COMPLY WITH SECTION 1710.8.2.

DOORS APPROVED FOR INSTALLATIONS WHERE AIR INFILTRATION RESISTANCE IS REQUIRED.

Test Pressure = 6.24 Psf
Measured Flow = 0.04 cfm/ft²

PRODUCT APPROVED
as complying with the Florida
Building Code
NOA-No. **17-0215.10**
Approval Date: **04/20/2017**
By *[Signature]*
Miami-Dade Product Control

MAR 29 2017

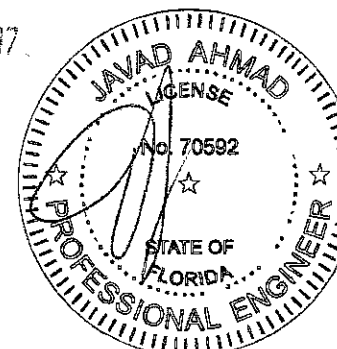

S-2000 (16-2) ALUM/GLASS SECTIONAL GARAGE DOOR (L.M.I.)
SIW IMPACT WINDOWS, LLC.
975 S. CONGRESS AVE. #102
DELRAY BEACH, FL. 33445
TEL. (561) 274-9392 FAX. (561) 274-9262

| revisions: | no. | date | by | description |
|------------|-----|----------|----|----------------------------|
| | A | 03.23.17 | | REV. PER REVISION COMMENTS |

date: 02-09-17
scale: 1/2" = 1"
dr. by: TARIQ
chk. by:

drawing no.
17-04
sheet 1 of 7

afC
AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
9360 SUNSET DRIVE, SUITE 220
MIAMI, FLORIDA 33173 (C.A.N. 3658)
TEL (305) 264-8500 FAX (305) 262-6978
COMP-ANL\W17-04SIW


afc

AL-FAROOQ CORPORATION
 ENGINEERS & PRODUCT DEVELOPMENT
 9360 SUNSET DRIVE, SUITE 220
 MIAMI, FLORIDA 33173 (C.A.N. 3538)
 TEL. (305) 264-8100 FAX. (305) 262-6978
 COMP-ANL\W17-04SIW

S-2000 (16-2) ALUM/GLASS SECTIONAL GARAGE DOOR (L.M.I.)
SIW IMPACT WINDOWS, LLC.
 975 S. CONGRESS AVE. #102
 DELRAY BEACH, FL. 33445
 TEL. (561) 274-9392 FAX. (561) 274-9262

| | | | | | |
|-------------|----------|----------|-------------|----------|----------|
| revisions: | no. | date | description | rev. per | comments |
| | A | 03.23.17 | | | |
| date: | 02-09-17 | scale: | 1/2"=1'-0" | dr. by: | TARIQ |
| | | | | chk. by: | |
| drawing no. | | | 17-04 | | |
| sheet | | | 2 of 7 | | |

- 5-1/2" X 3 1/2" X 12 GA. ST. STEEL TOP BRACKET W/ (6) #14 X 5/8" SMS
- 7-1/2" X 3" X 12 GA. ST. STEEL END ROLLER HINGE W/ (4) #14 X 5/8" SMS
- 3" X 3" X 12 GA. ST. STEEL CUT-DOWN HINGE W/ (4) #14 X 5/8" SMS
- 2/ DOOR
- 1" W X .15 THK. LATCH
- STANDARD LOCK SPRING LOADED SLIDE BOLT (BOTH SIDES) FASTENED W/ (4) #14 X 1/2" S.M.S. 5/8" MIN. LOCK ENGAGEMENT CONFORMS TO SECTION 1008 REGARDING GARAGE DOORS
- .158 DIA. ST. STEEL CABLE & NICO-PRESS SLEEVE W/ MIN. 5 TO 1 SAFETY FACTOR
- 7-7/8" X 3-1/8" X 12 GA. ST. STEEL PLATE WITH (6) #14 X 3/4" SDS

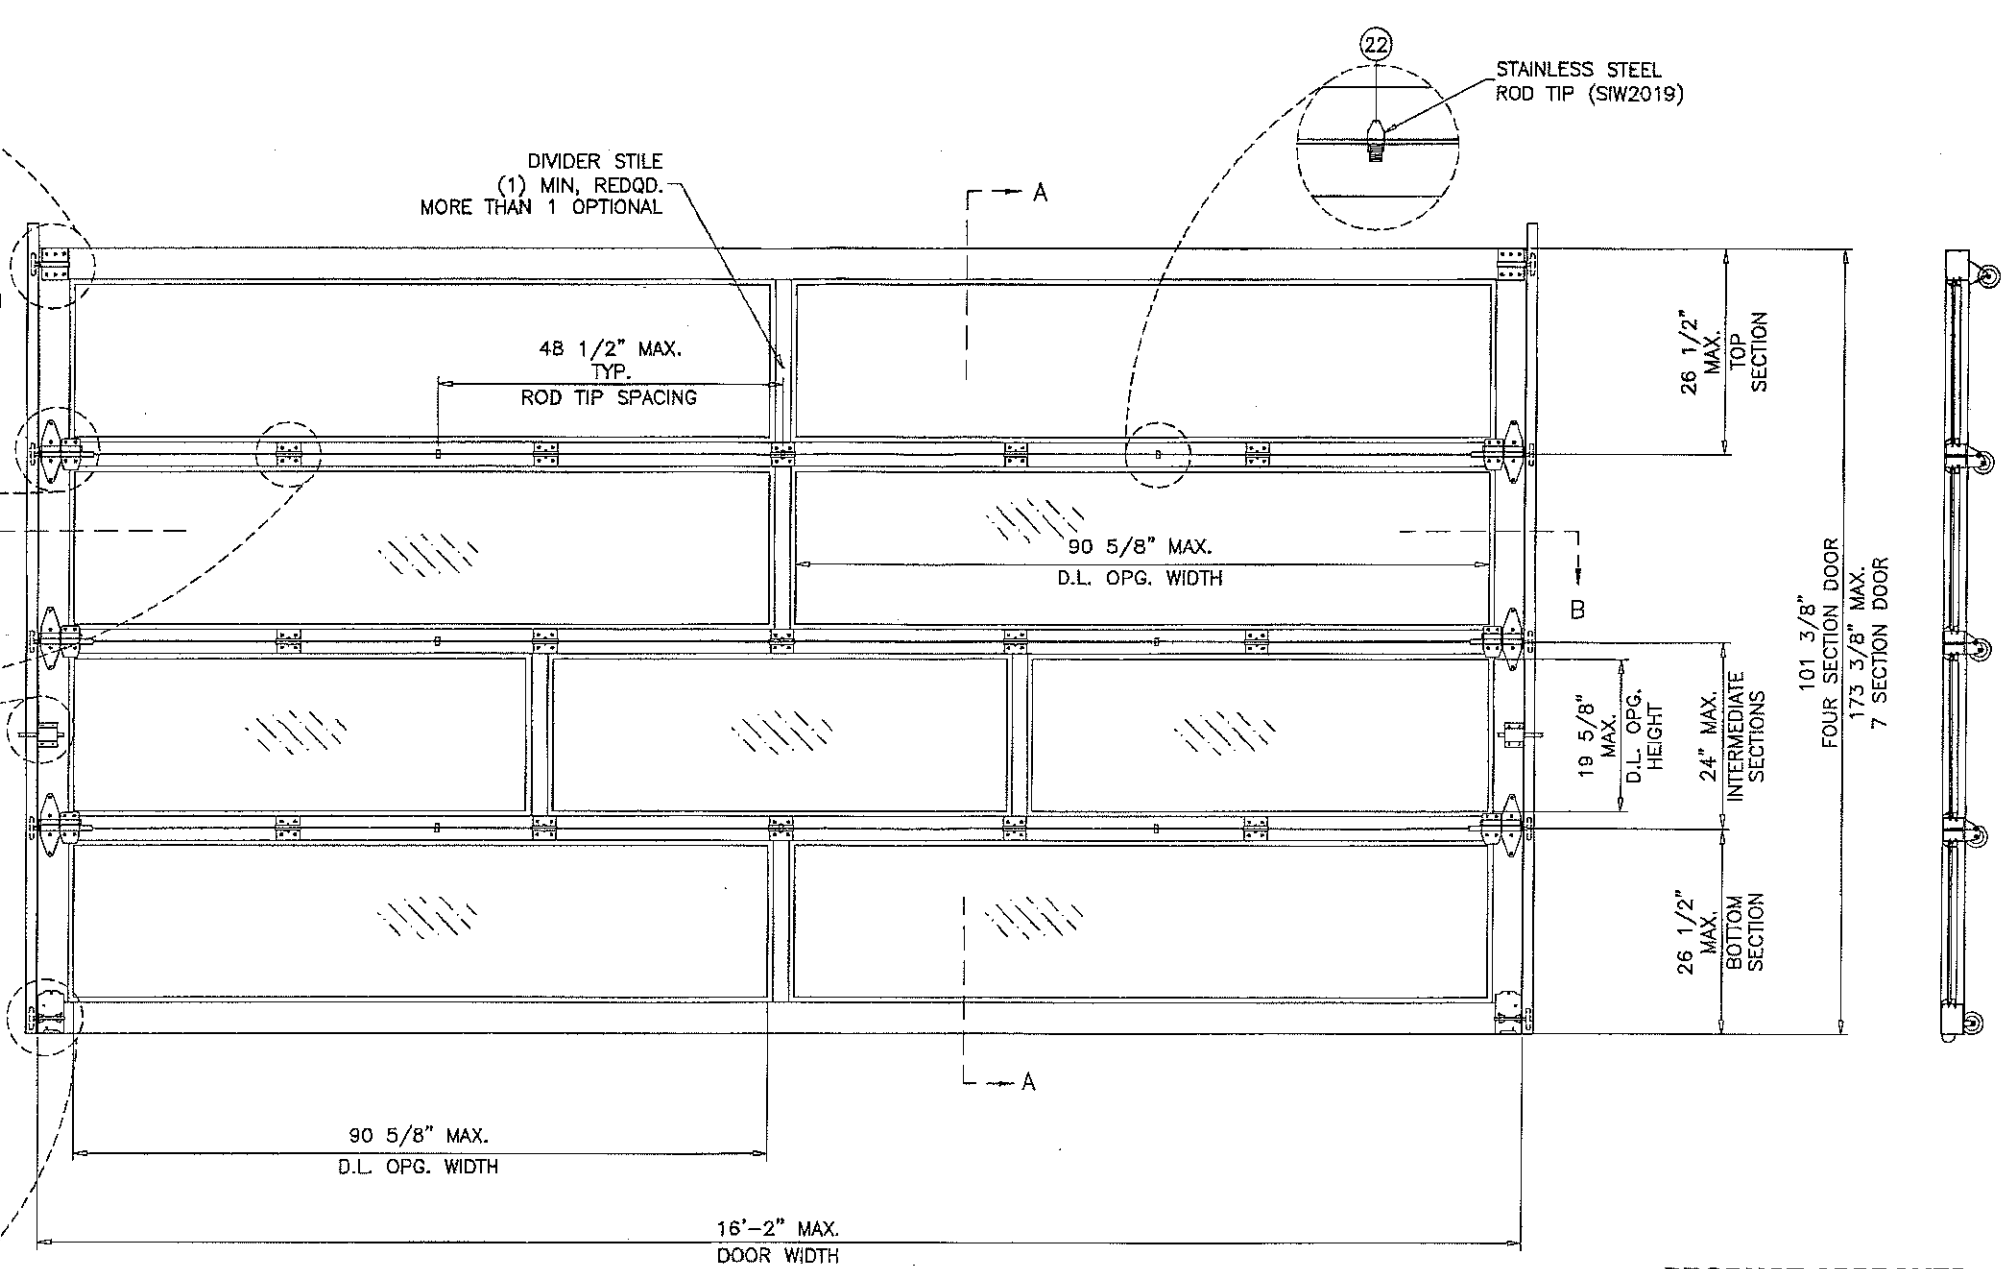


INSIDE ELEVATION


PRODUCT APPROVED
 as complying with the Florida Building Code
 NOA-No. **17-0215.10**
 Approval Date, **04/20/2017**
 By *[Signature]*
 Miami-Dade Product Control

MAXIMUM DESIGN LOAD RATING = + 46.0 PSF
 (FOR SIZES SHOWN OR SMALLER) - 56.0 PSF

| NOMINAL DOOR HEIGHT | CONSISTS OF | |
|---------------------|-----------------------|-------------------------|
| | INTERMEDIATE SECTIONS | TOP AND BOTTOM SECTIONS |
| 8'-6" | 2 SECTIONS 24" HIGH | 2 SECTIONS 26-1/2" HIGH |
| 10'-6" | 3 SECTIONS 24" HIGH | 2 SECTIONS 26-1/2" HIGH |
| 12'-6" | 4 SECTIONS 24" HIGH | 2 SECTIONS 26-1/2" HIGH |
| 14'-6" | 5 SECTIONS 24" HIGH | 2 SECTIONS 26-1/2" HIGH |

MAR 29 2017

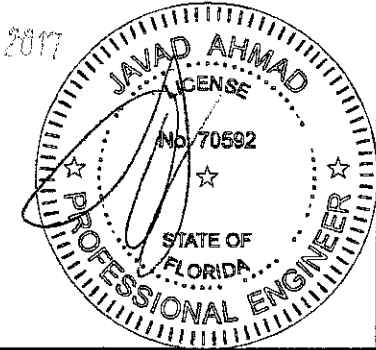

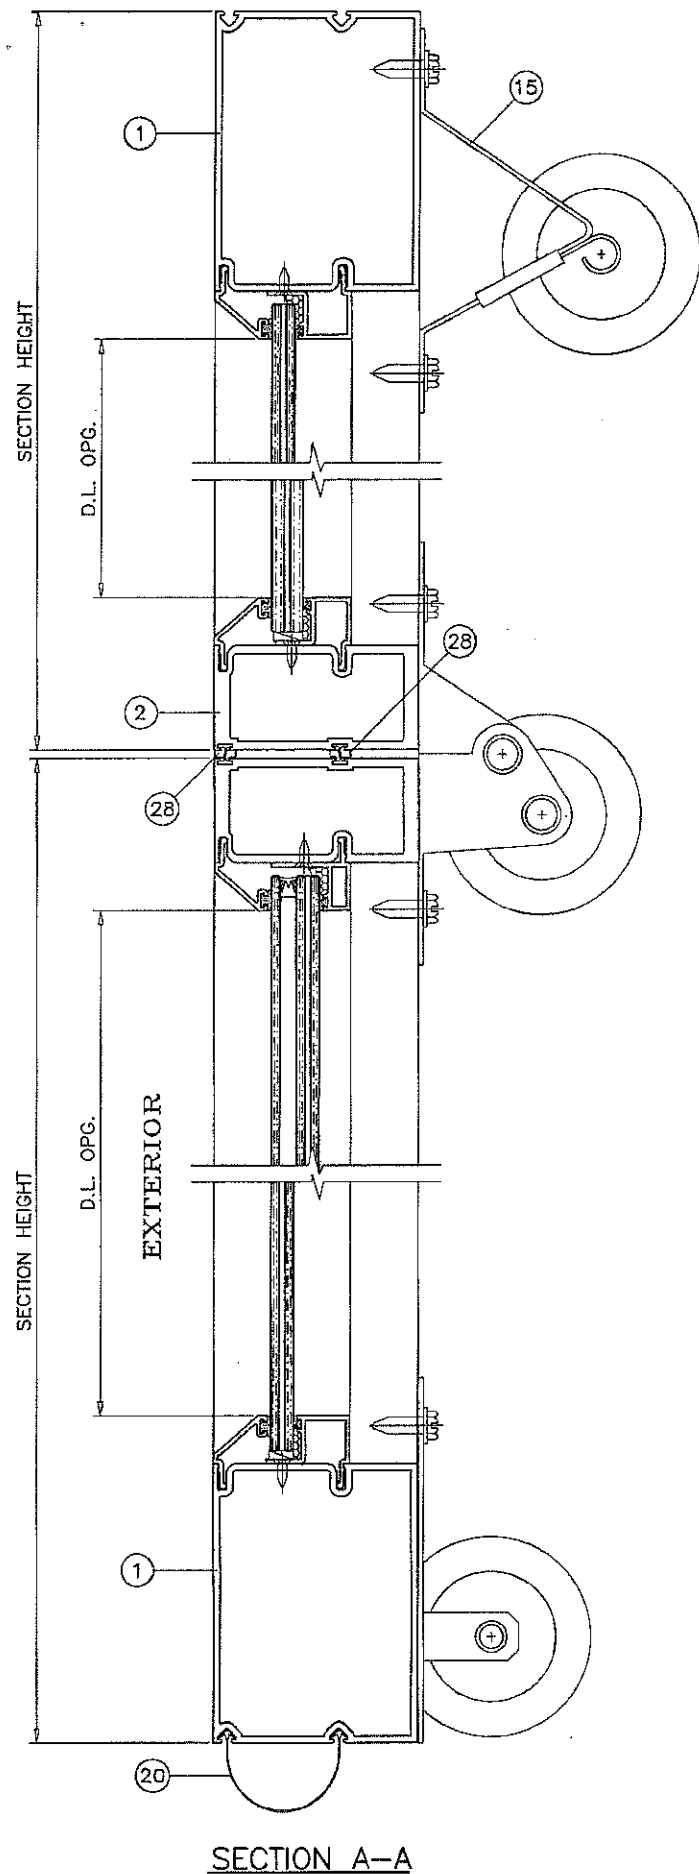


SECTION A-A

| ITEM # | PART # | REQD. | DESCRIPTION | MATERIAL | MANF./SUPPLIER/REMARKS |
|--------|-----------|------------|---|---------------|--|
| 1 | SIW2001 | 2 | TOP AND BOTTOM RAIL | 6063-T6 | - |
| 2 | SIW2002 | AS REQD. | INTERMEDIATE RAIL | 6063-T6 | - |
| 3 | SIW2004 | 2/ SECTION | VERTICAL END STILE | 6063-T6 | - |
| 4 | SIW816 | AS REQD. | VERTICAL DIVIDER STILE | 6063-T6 | - |
| 5 | SIW2005 | 4/ SECTION | INTERIOR GLASS STOP (5/16" GLASS) | 6063-T6 | - |
| 5A | SIW2007 | 4/ SECTION | ALT. INTERIOR GLASS STOP (5/16" GLASS) | 6063-T6 | - |
| 6 | SIW2012 | 4/ SECTION | INTERIOR GLASS STOP (7/16" GLASS) | 6063-T6 | - |
| 7 | SIW2013 | 4/ SECTION | INTERIOR GLASS STOP (INSUL. LAM. GLASS) | 6063-T6 | - |
| 8 | SIW2006 | 4/ SECTION | EXTERIOR GLASS STOP | 6063-T6 | - |
| 8A | SIW2008 | 4/ SECTION | ALT. EXTERIOR GLASS STOP | 6063-T6 | - |
| 9 | SIW2009 | AS REQD. | SEAL HOUSING | 6063-T6 | - |
| 10 | SIW303 | AS REQD. | SNAP COVER | 6063-T6 | - |
| 11 | SIW2015 | 2 | DOOR TRACK | ST. STEEL | - |
| 12 | SIW2015B | 2 | INSTALLATION ANGLE | ST. STEEL | - |
| 13 | SIW2016 | AS REQD. | TRACK BRACKET | ST. STEEL | - |
| 14 | H101 | AS REQD. | UNIVERSAL HINGES | ST. STEEL | - |
| 14A | H102 | AS REQD. | UNIVERSAL HINGES (CUT DOWN) | ST. STEEL | - |
| 15 | H103 | 2 | TOP FIXTURE | ST. STEEL | - |
| 16 | H104 | 2 | BOTTOM FIXTURE | ST. STEEL | - |
| 17 | H106 | AS REQD. | OVERHEAD CUT DOWN HINGE | ST. STEEL | - |
| 18 | H105 | 2 | STANDARD LOCK | - | - |
| 19 | SIW2017 | AS REQD. | 3" ROLLER WITH 11" STEM | STEEL | - |
| 20 | SIW2011 | 1 | BOTTOM SEAL | SANTOPRENE | CENTRAL PLASTICS |
| 21 | SIW2010 | AS REQD. | OUTER SEAL | POLYPROPYLENE | MELTPOINT PLASTICS |
| 22 | SIW2019 | - | ROD TIP | ST. STEEL | - |
| 23 | 5530 | AS REQD. | INTERIOR GLAZING GASKET | SANTOPRENE | CENTRAL PLASTICS, DUROMETER 70±5 SHORE A |
| 24 | 5531 | AS REQD. | EXTERIOR GLAZING GASKET | SANTOPRENE | CENTRAL PLASTICS, DUROMETER 70±5 SHORE A |
| 25 | - | 2/ LITE | SETTING BLOCKS AT 1/4 POINTS | EPDM | DUROMETER 85±5 SHORE A |
| 26 | #8 X 1/2" | AS REQD. | GLASS STOP SCREWS | ST. STEEL | FH SELF DRILLING, AT 6" FROM ENDS & 24" O.C. |
| 27 | H107 | 2 | 5/32" SPRING LIFT CABLE | ST. STEEL | - |
| 28 | SIW811 | AS REQD. | BULB W'STRIPPING AT INTERMEDIATE RAIL | PVC | - |
| 29 | #12 X 2" | AS REQD. | ASSEMBLY FASTENERS | ST. STEEL | PH SMS |

PRODUCT APPROVED
 as complying with the Florida
 Building Code
 NOA-No. **17-0215.10**
 Approval Date **04/20/2017**
 By *[Signature]*
 Miami-Dade Product Control

1519 29 2017

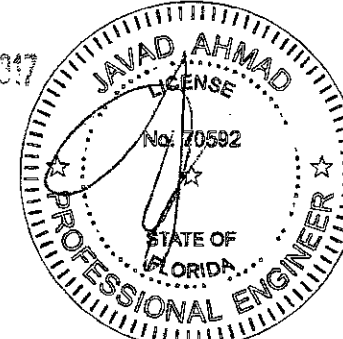

af c
AL-FAROOQ CORPORATION
 ENGINEERS & PRODUCT DEVELOPMENT
 9360 SUNSET DRIVE, SUITE 220
 MIAMI, FLORIDA 33173 (C.A.N. 3538)
 TEL. (305) 264-8100 FAX. (305) 262-6978
 COMP-ANL\W17-04SIW

S-2000 (16-2) ALUM/GLASS SECTIONAL GARAGE DOOR (L.M.I.)
SIW IMPACT WINDOWS, LLC.
 975 S. CONGRESS AVE. #102
 DELRAY BEACH, FL. 33445
 TEL. (561) 274-9392 FAX. (561) 274-9262

| | | | | |
|-------------|-----------|----------|----|-----------------------|
| revisions: | no. | date | by | description |
| | A | 03/23/17 | | REV. PER PER COMMENTS |
| date: | 02-09-17 | | | |
| scale: | 3/8" = 1" | | | |
| dr. by: | TARIQ | | | |
| chk. by: | | | | |
| drawing no. | 17-04 | | | |
| sheet | 3 of 7 | | | |

afc


AL-FAROQ CORPORATION
 ENGINEERS & PRODUCT DEVELOPMENT
 9360 SUNSET DRIVE, SUITE 220
 MIAMI, FLORIDA 33173 (C.A.N. 3538)
 TEL. (305) 262-6978 FAX. (305) 262-6978
 COMP-ANL\W17-04SIW

S-2000 (16-2) ALUM/GLASS SECTIONAL GARAGE DOOR (L.M.I.)
SIW IMPACT WINDOWS, LLC.
 975 S. CONGRESS AVE. #102
 DELRAY BEACH, FL 33445
 TEL. (561) 274-9392 FAX. (561) 274-9262


| revisions: | no. | date | by | description |
|------------|-----|----------|----|-----------------------|
| | A | 03.23.17 | | REV. PER RER COMMENTS |

date: 02-09-17
 scale: 3/8" = 1"
 dr. by: TARIQ
 chk. by:

drawing no.
17-04
 sheet 4 of 7

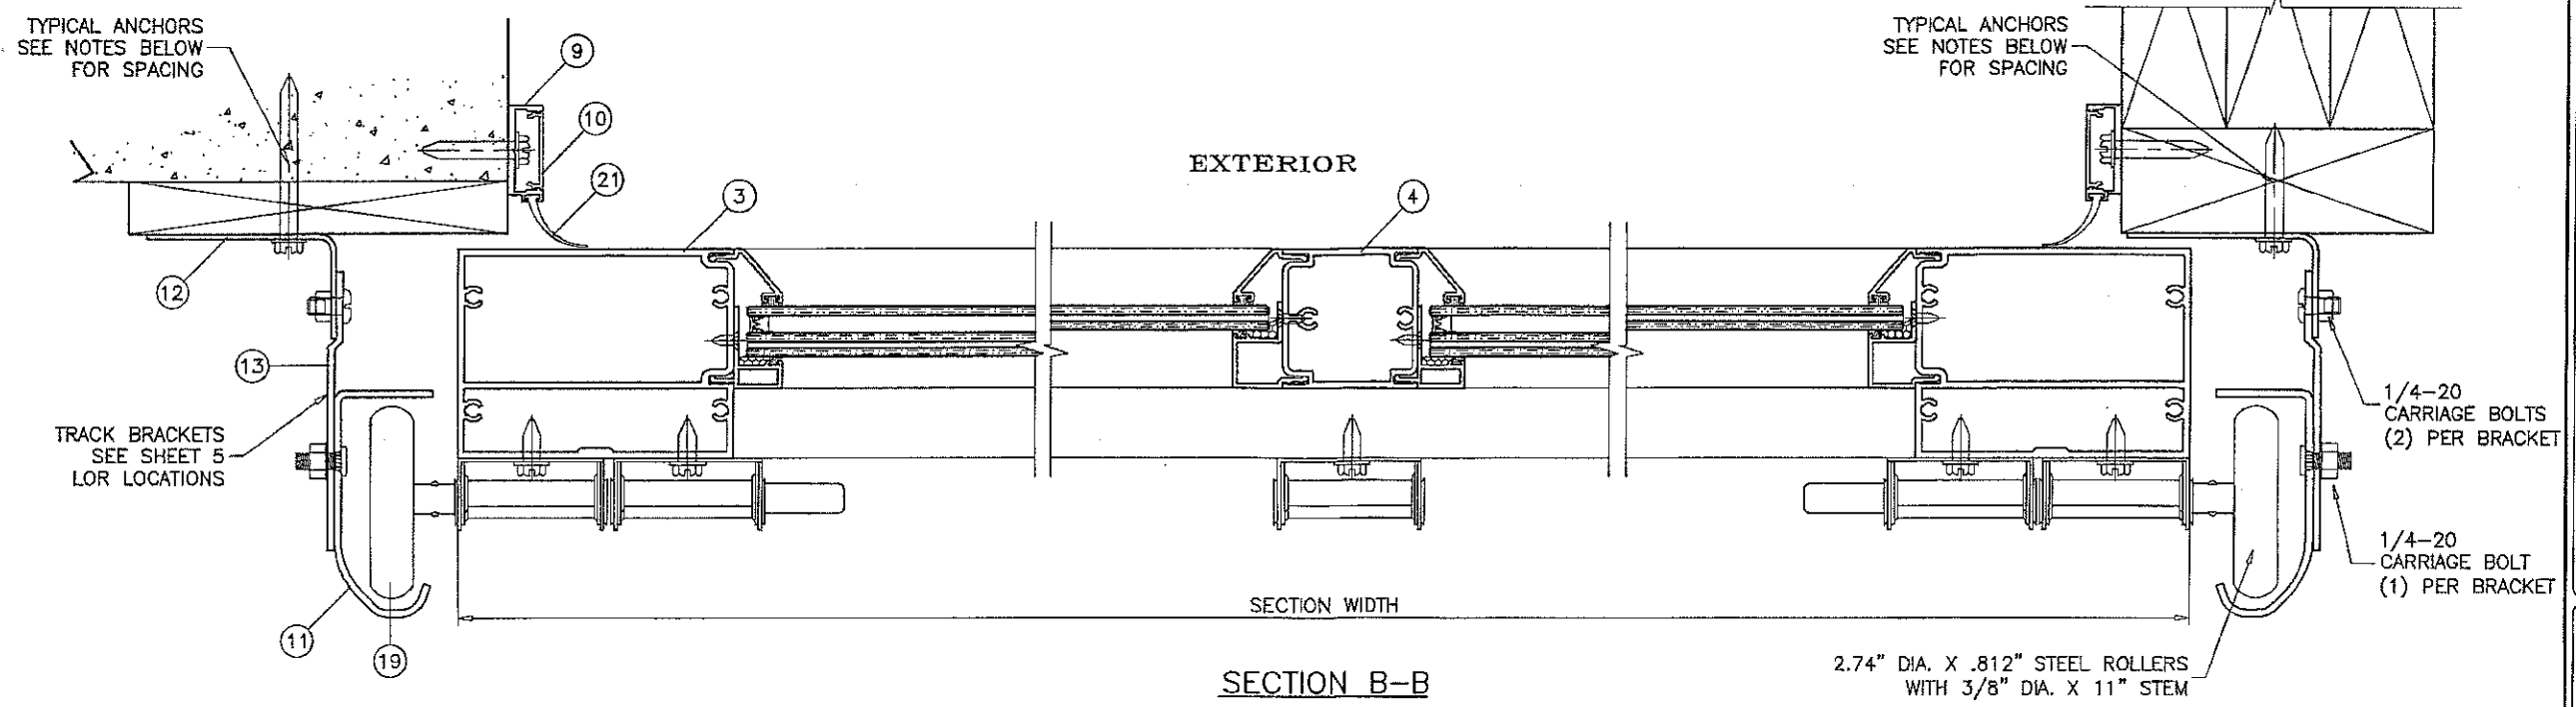

SECTION B-B

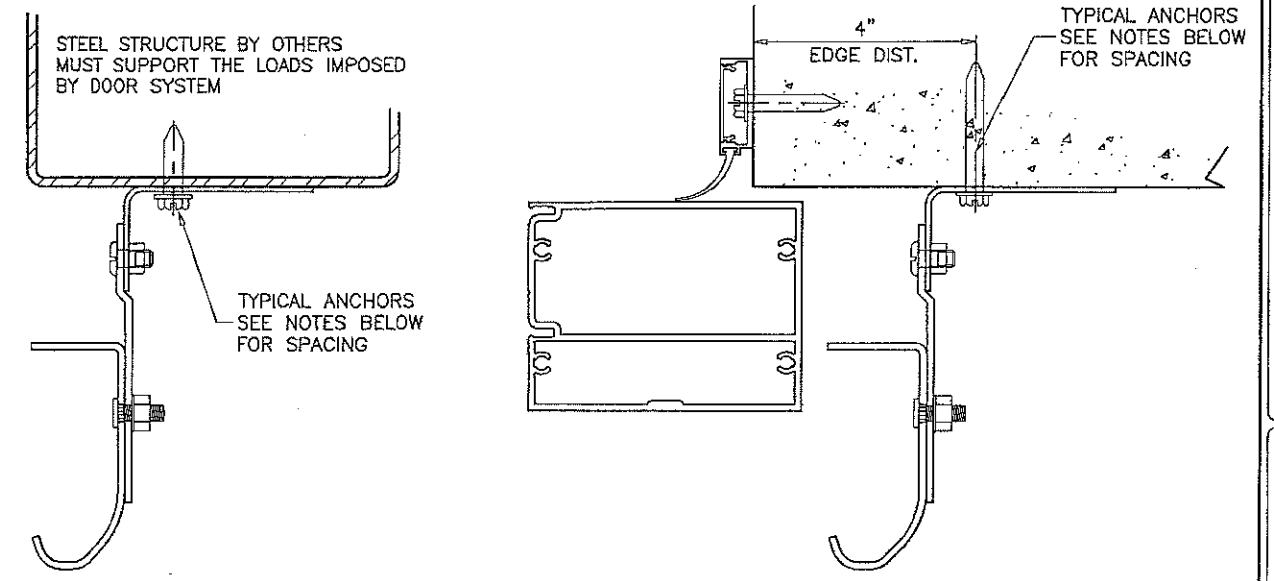



TYPICAL ANCHORS:

- 5/16" DIA. ULTRACON BY 'ELCO'** (Fu=177 KSI, Fy=155 KSI)
 INTO WOOD STRUCTURES
 2" MIN. PENETRATION INTO WOOD
 AT 2" FROM BOTTOM AND 10" O.C. MAX.
- THRU 1BY OR 2BY BUCKS INTO CONCRETE
 2" MIN. EMBED INTO CONCRETE
 AT 2" FROM BOTTOM AND 10" O.C. MAX.
- DIRECTLY INTO CONCRETE
 2" MIN. EMBED INTO CONCRETE
 AT 2" FROM BOTTOM AND 10" O.C. MAX.
- 3/8" DIA. KWIK BOLT 3 EXPANSION ANCHOR BY 'HILTI'**
 DIRECTLY INTO MASONRY
 2-1/2" MIN. EMBED INTO FILLED BLOCKS
 AT 2" FROM BOTTOM AND 8" O.C. MAX.
 4" MIN. EDGE DISTANCE
- 5/16" DIA. DRIL-FLEX SCREWS BY 'ELCO'** (Fu=100 KSI, Fy=65 KSI)
 INTO STEEL STRUCTURES
 AT 2" FROM BOTTOM AND 7-1/2" O.C. MAX.
 STEEL: 1/8" THK. MIN. (Fy = 36 KSI MIN.)
 (STEEL IN CONTACT WITH ALUMINUM TO BE PLATED OR PAINTED)
- 5/16" DIA. LAG SCREWS**
 INTO WOOD STRUCTURES
 2" MIN. PENETRATION INTO WOOD
 AT 2" FROM BOTTOM AND 10" O.C. MAX.
- TYPICAL EDGE DISTANCE**
 INTO CONCRETE = 3-1/8" MIN.
 INTO FILLED BLOCKS = 2-1/2" MIN.
 INTO WOOD STRUCTURE = 1-1/4" MIN.
 INTO METAL STRUCTURE = 3/4" MIN.
- WOOD SG = 0.55 MIN.
 CONCRETE f'c = 3000 PSI MIN.
 C-90 GROUT FILLED BLOCK f'm = 2000 PSI MIN.


PRODUCT APPROVED
 as complying with the Florida
 Building Code
 NOA-No. **17-0215.10**
 Approval Date **04/20/2017**
 By *[Signature]*
 Miami-Dade Product Control

MAR 29 2017

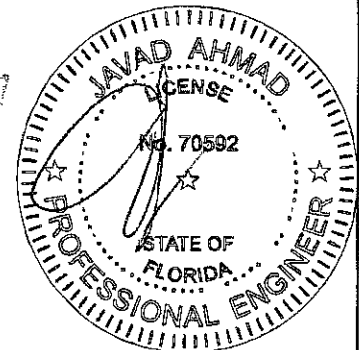

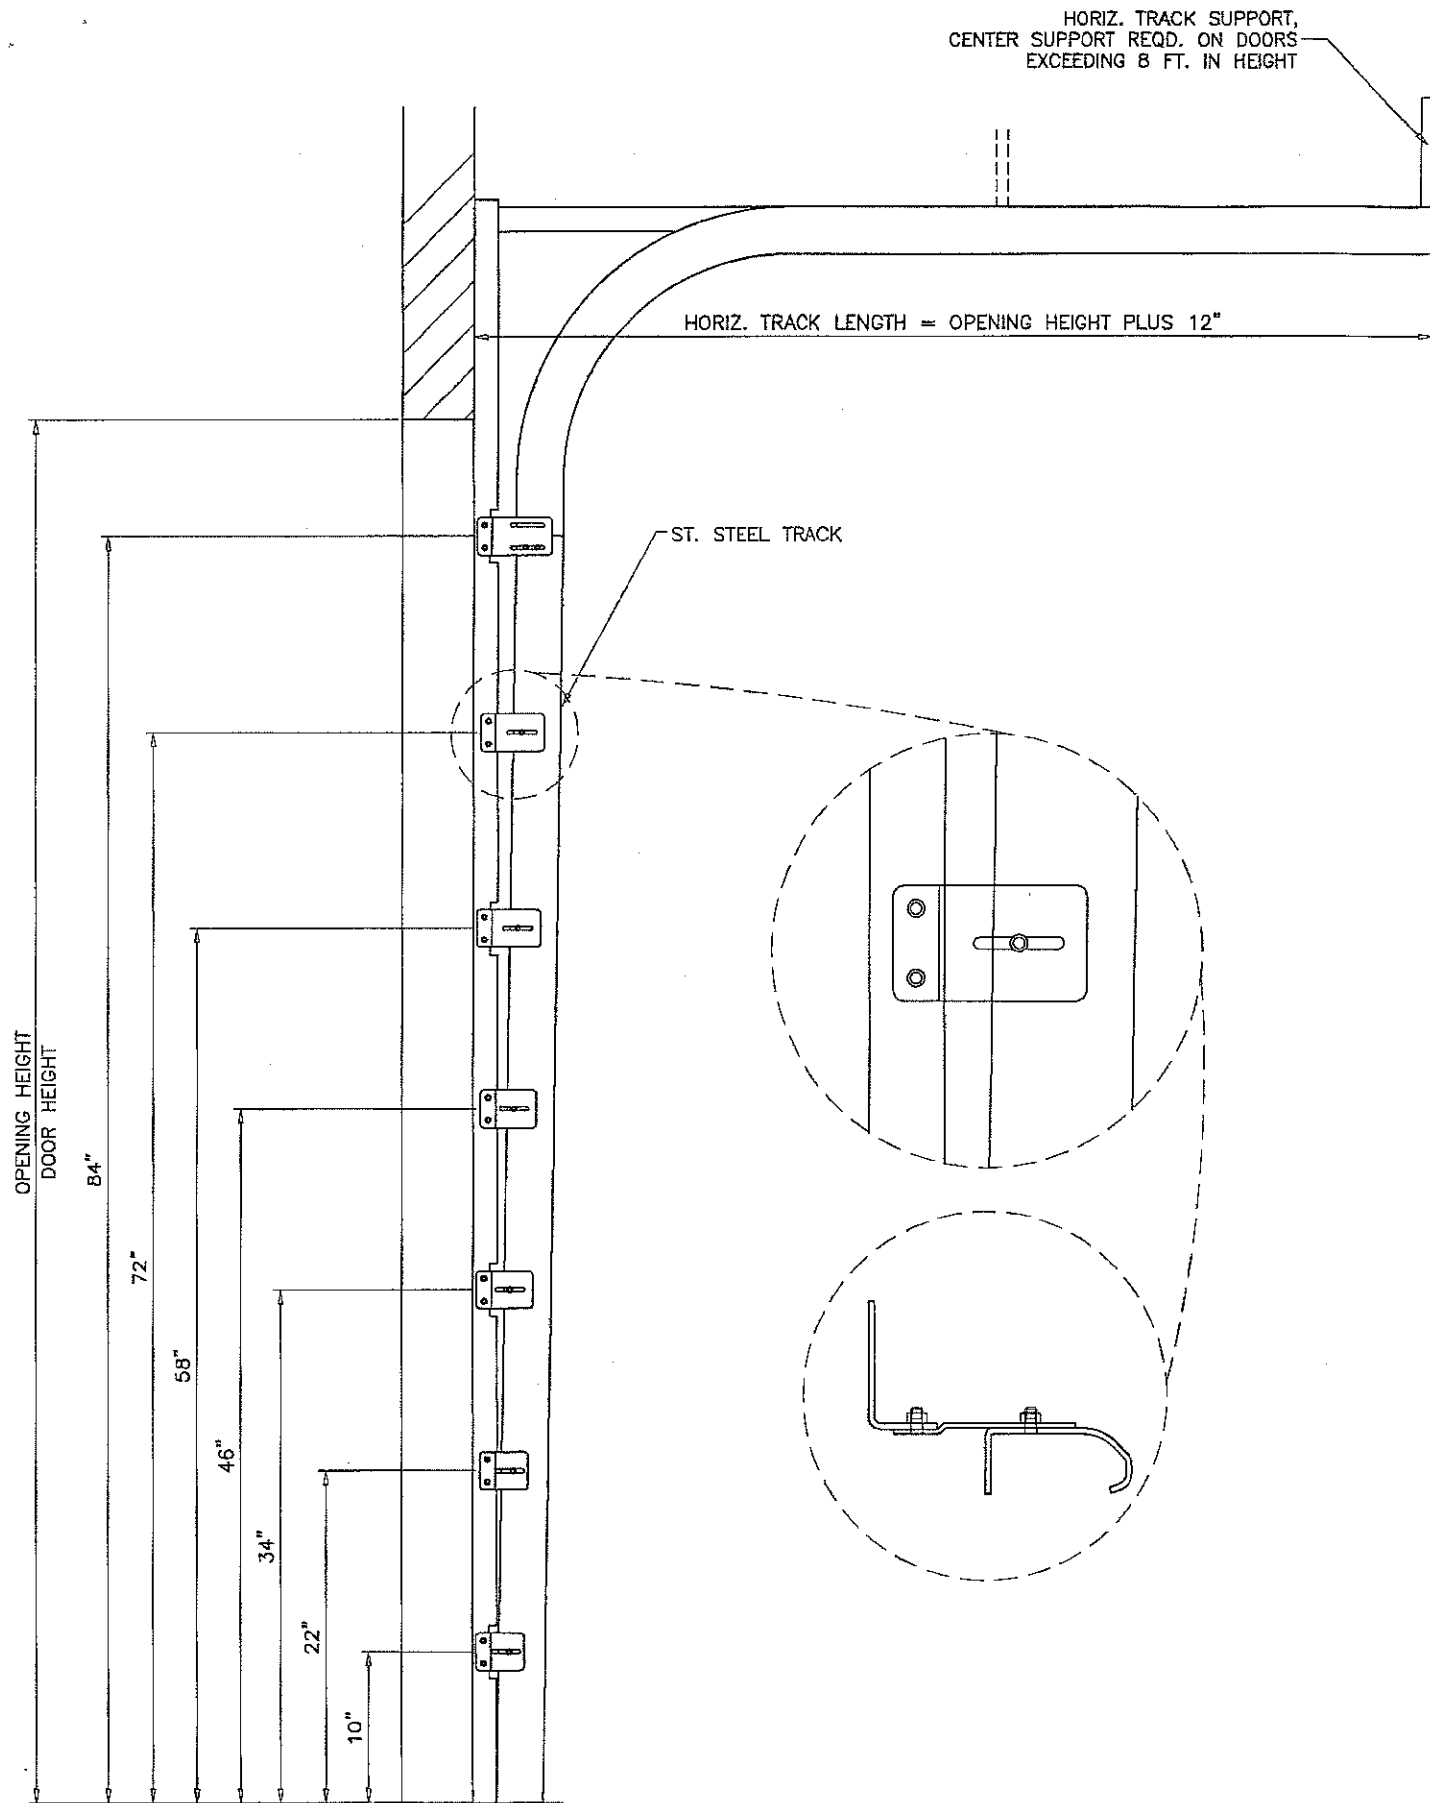


TRACK CONFIGURATION

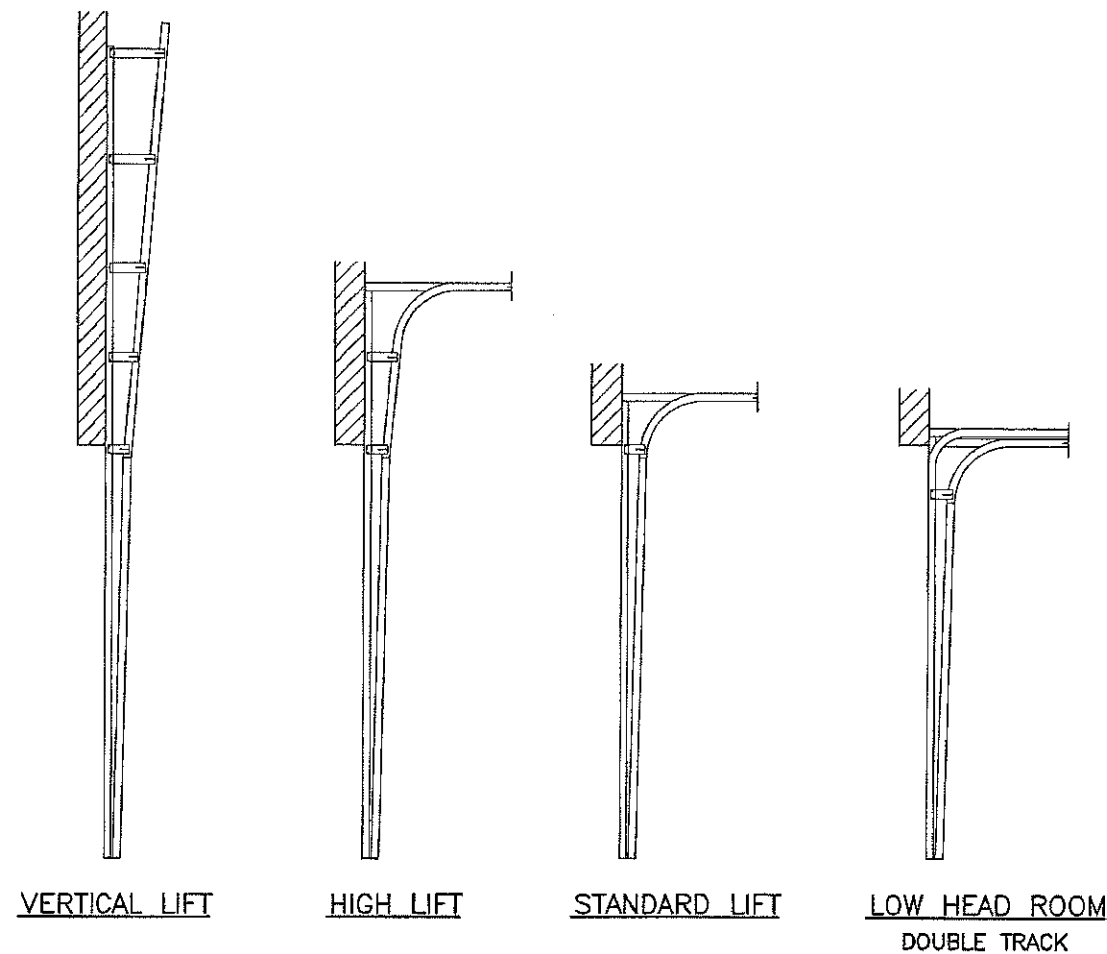

AVAILABLE TRACK OPTIONS

PRODUCT APPROVED
 as complying with the Florida
 Building Code
 NOA-No. 17-0215.10
 Approval Date 04/20/2017
 By *[Signature]*
 Miami-Dade Product Control

MAR 29 2017

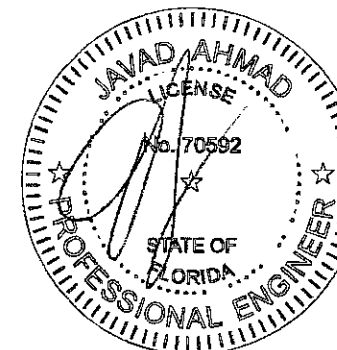


af c
AL-FAROOQ CORPORATION
 ENGINEERS & PRODUCT DEVELOPMENT
 9360 SUNSET DRIVE, SUITE 220
 MIAMI, FLORIDA 33173 (C.A.N. 3538)
 TEL. (305) 264-8100 FAX. (305) 262-6978
 COMP-ANL W17-04SIW


S-2000 (16-2) ALUM/GLASS SECTIONAL GARAGE DOOR (L.M.I.)
SIW IMPACT WINDOWS, LLC.
 975 S. CONGRESS AVE. #102
 DELRAY BEACH, FL. 33445
 TEL. (561) 274-9392 FAX. (561) 274-9262

| NO. | DATE | DESCRIPTION |
|-----|----------|----------------------|
| A | 03.23.17 | NO CHANGE THIS SHEET |
| | | |
| | | |
| | | |


date: 02-09-17
 scales: 3/8" = 1"
 dr. by: TARIQ
 chk. by:
 drawing no. 17-04
 sheet 5 of 7

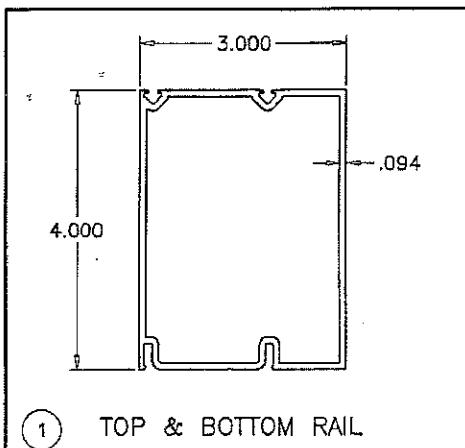


1 TOP & BOTTOM RAIL

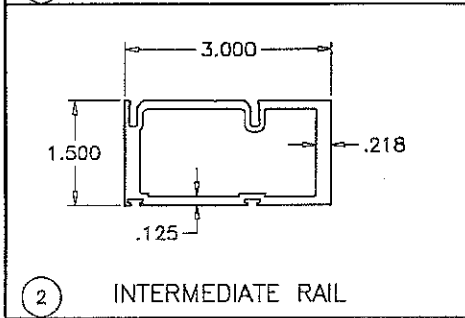


2 INTERMEDIATE RAIL

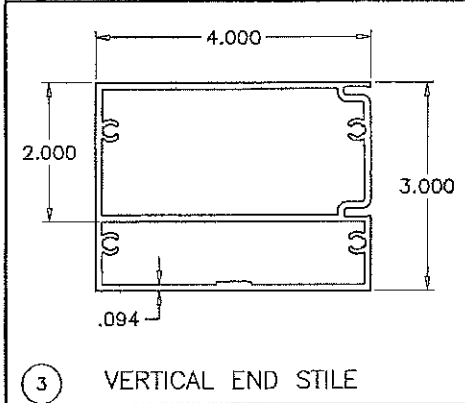


3 VERTICAL END STILE

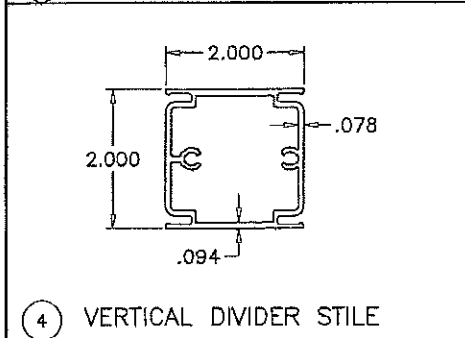


4 VERTICAL DIVIDER STILE

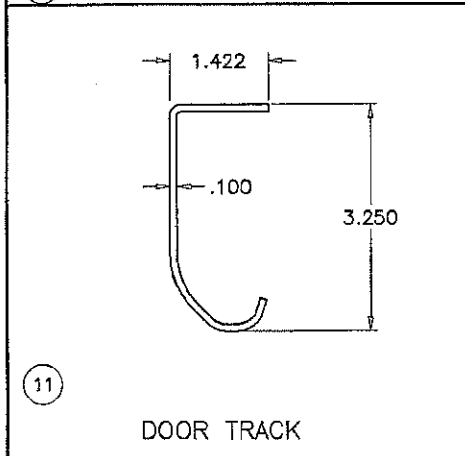


11 DOOR TRACK

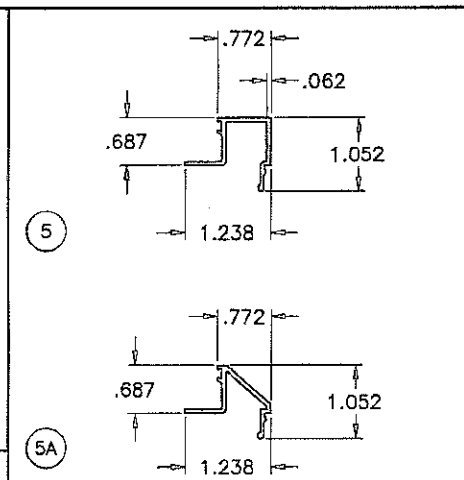


5A INTERIOR GLASS STOP
5/16" LAM. GLASS

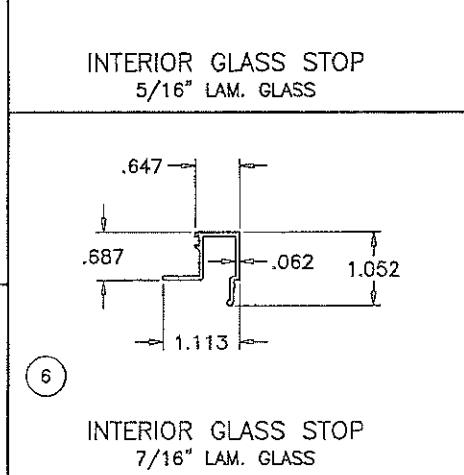


6 INTERIOR GLASS STOP
7/16" LAM. GLASS

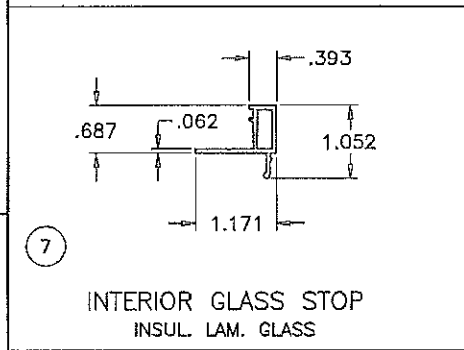


7 INTERIOR GLASS STOP
INSUL. LAM. GLASS

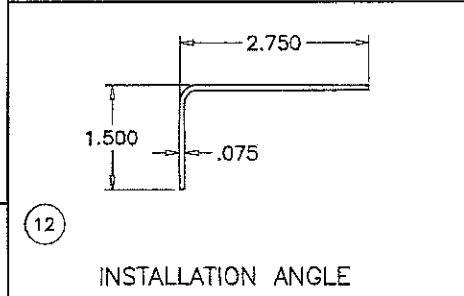


12 INSTALLATION ANGLE

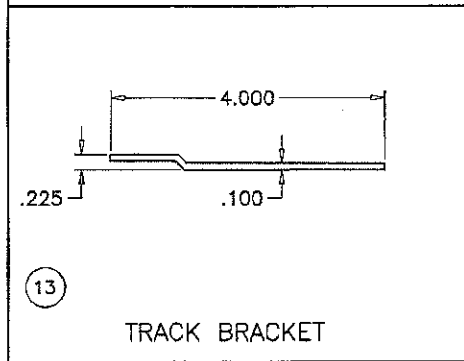


13 TRACK BRACKET

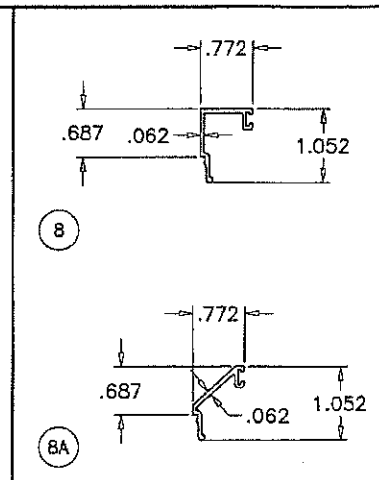


8 EXTERIOR GLASS STOP
5/16", 7/16" & INSUL. GLASS

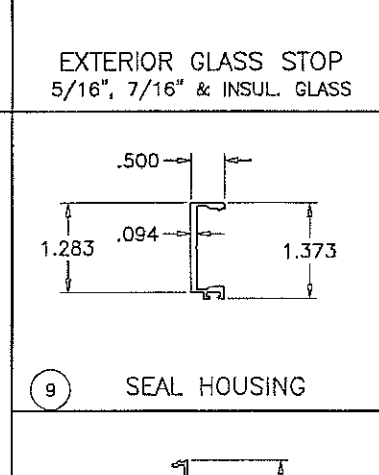


9 SEAL HOUSING

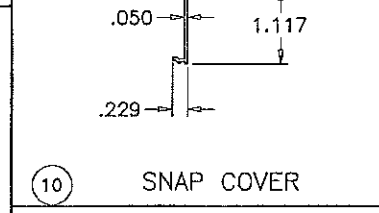


10 SNAP COVER

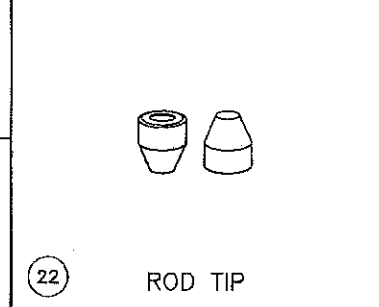


22 ROD TIP

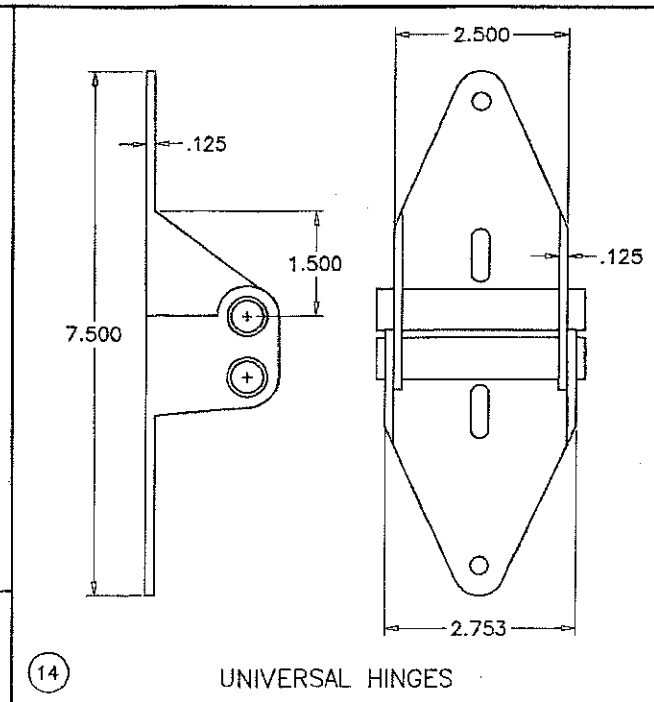


14 UNIVERSAL HINGES

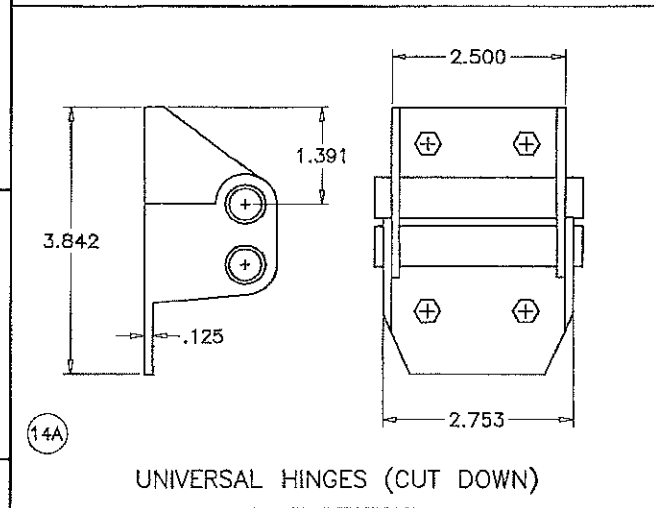


14A UNIVERSAL HINGES (CUT DOWN)

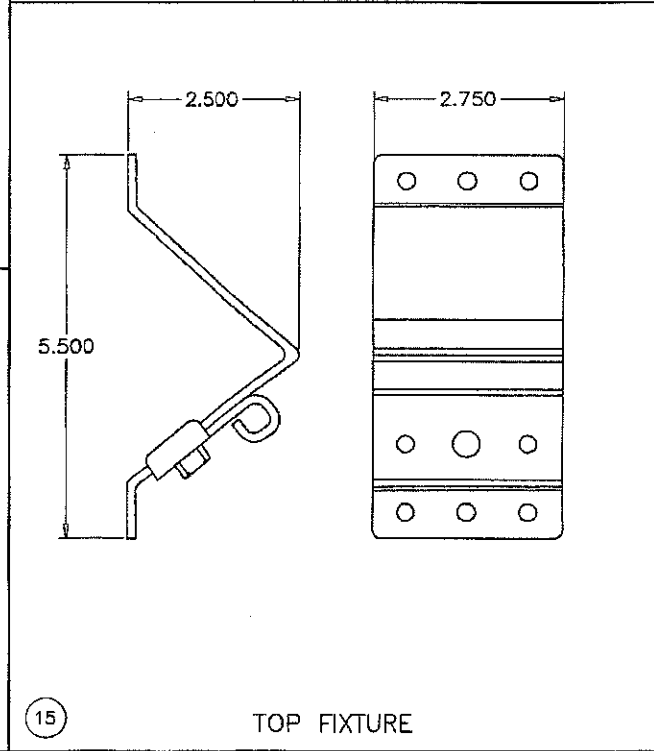

15 TOP FIXTURE

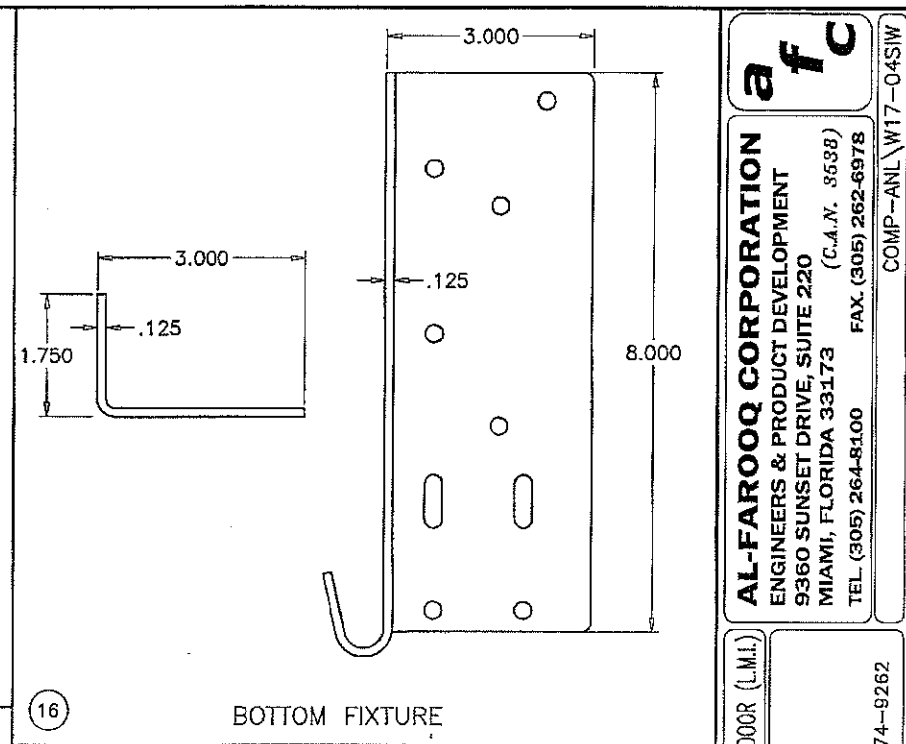


16 BOTTOM FIXTURE

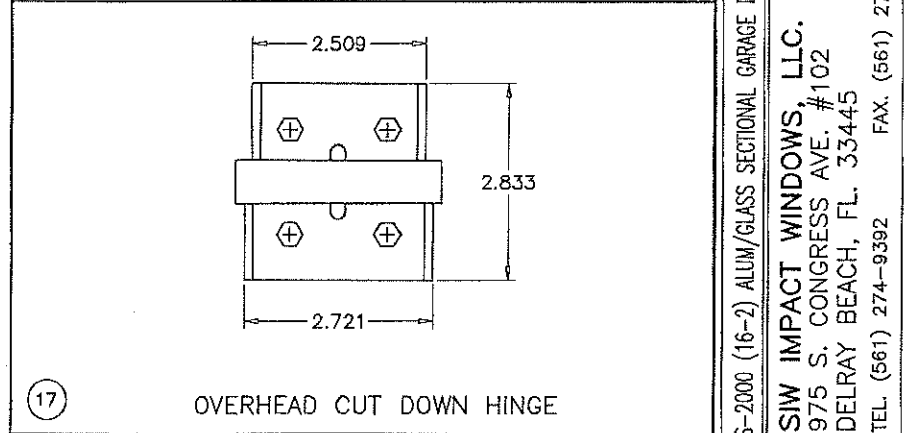

17 OVERHEAD CUT DOWN HINGE

PRODUCT APPROVED
as complying with the Florida
Building Code
NOA-No. **17-0215.10**
Approval Date **04/20/2017**
By *[Signature]*
Miami-Dade Product Control


MAR 29 2017

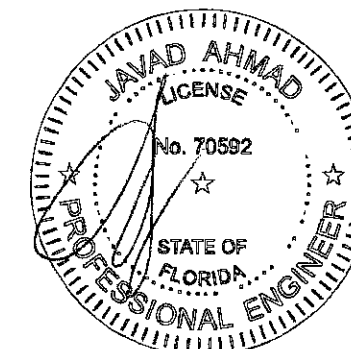


af c
AL-FAROOQ CORPORATION
ENGINEERS & PRODUCT DEVELOPMENT
9360 SUNSET DRIVE, SUITE 220
MIAMI, FLORIDA 33173
TEL. (305) 264-8100 FAX. (305) 262-6978
COMP-ANL\W17-04SIW

S-2000 (16-2) ALUM/GLASS SECTIONAL GARAGE DOOR (L.M.I.)
SIW IMPACT WINDOWS, LLC.
975 S. CONGRESS AVE. #102
DELRAY BEACH, FL. 33445
TEL. (561) 274-9392 FAX. (561) 274-9262


| | | | | |
|-------------|-----------|----------|----|----------------------|
| revisions: | no. | date | by | description |
| | A | 03.23.17 | | NO CHANGE THIS SHEET |
| date: | 02-09-17 | | | |
| scale: | 3/8" = 1" | | | |
| dr. by: | TARIQ | | | |
| chk. by: | | | | |
| drawing no. | 17-04 | | | |
| sheet | 6 of 7 | | | |

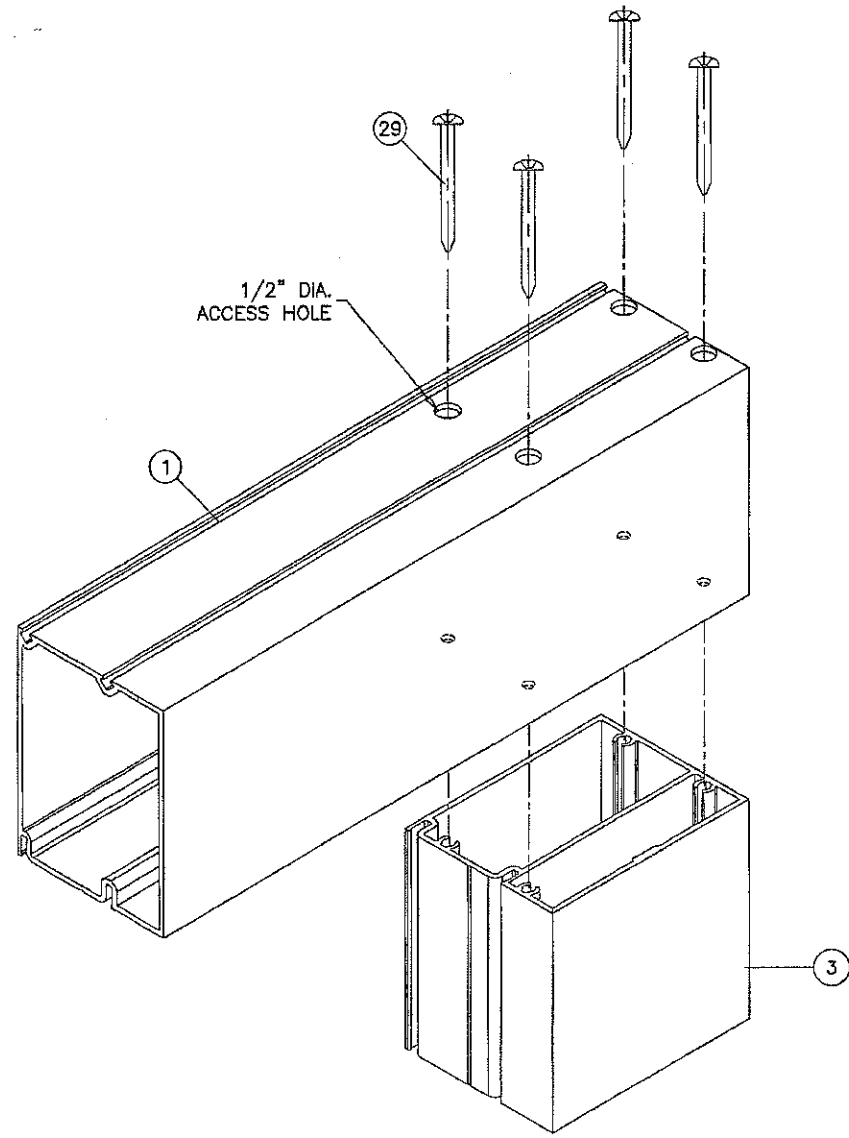

TOP/BOTTOM RAIL CORNER

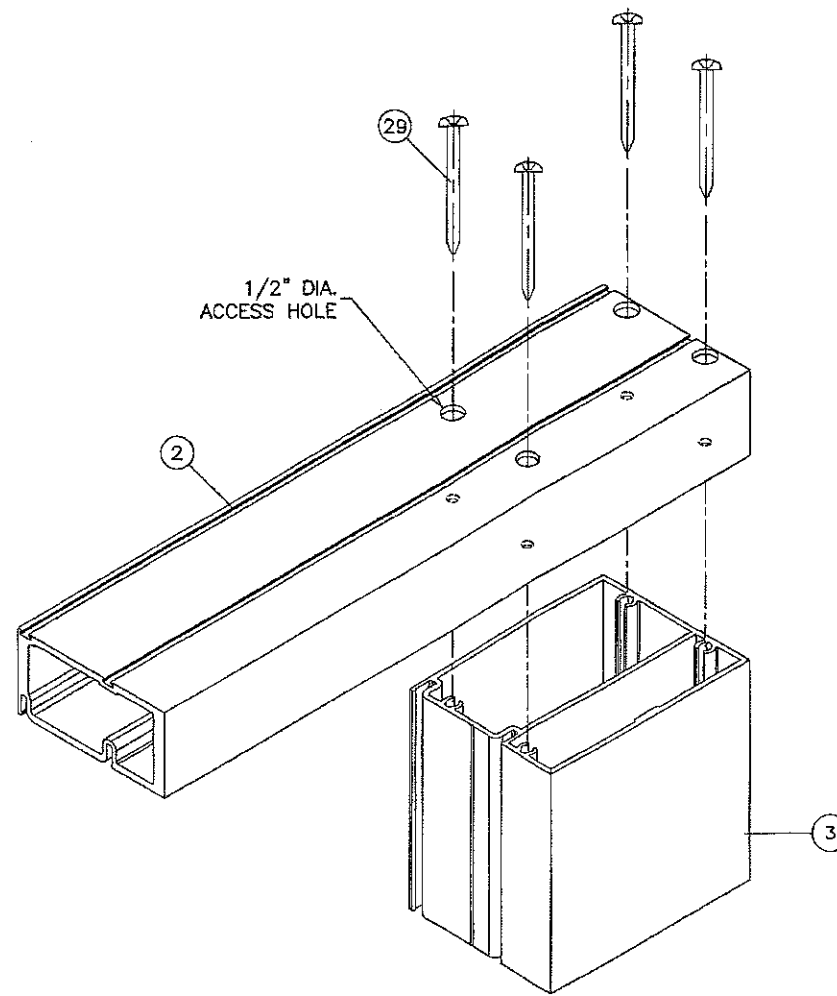


INTERMEDIATE RAIL CORNER

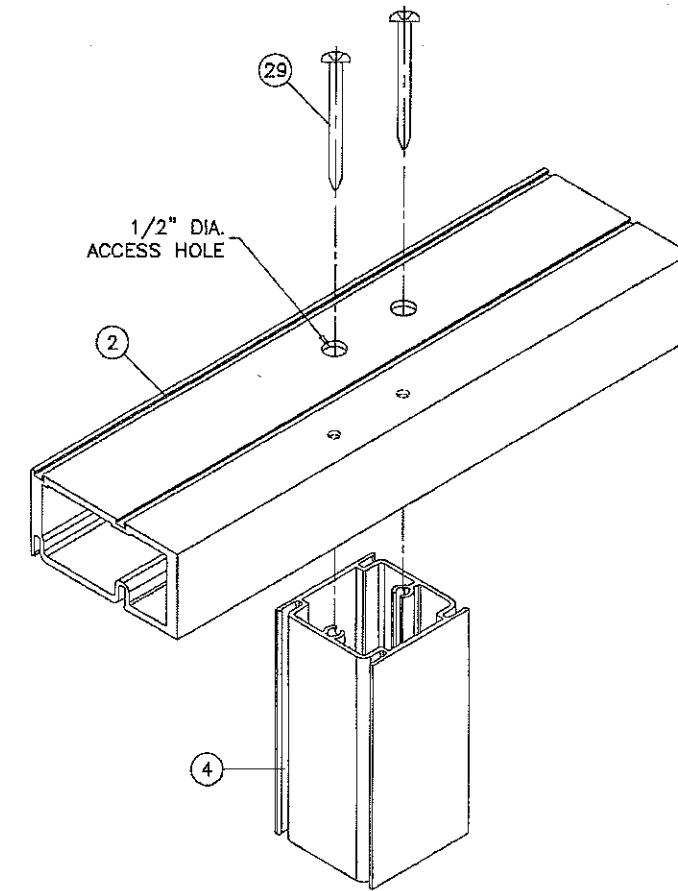

DIVIDER STILE CORNER

PRODUCT APPROVED
 as complying with the Florida
 Building Code
 NOA-No. **17-0215.10**
 Approval Date **04/20/2017**
 By *[Signature]*
 Miami-Dade Product Control

MAR 29 2017

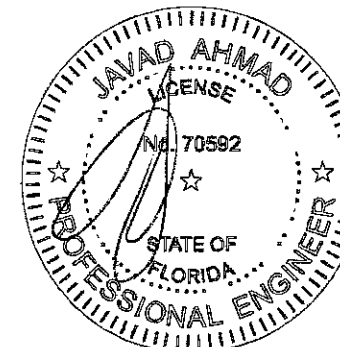

S-2000 (16-2) ALUM/GLASS SECTIONAL GARAGE DOOR (L.M.I.)
 SIW IMPACT WINDOWS, LLC.
 975 S. CONGRESS AVE. #102
 DELRAY BEACH, FL. 33445
 TEL. (561) 274-9392 FAX. (561) 274-9262

af c
AL-FAROOQ CORPORATION
 ENGINEERS & PRODUCT DEVELOPMENT
 9360 SUNSET DRIVE, SUITE 220 (C.A.#. 3538)
 MIAMI, FLORIDA 33173 TEL. (305) 262-6978
 FAX. (305) 264-8100
 COMP-ANL\W17-04SIW

| revisions: | no | date | by | description |
|-------------|-----------|----------|----|-----------------------|
| | A | 03.23.17 | | REV. PER RER COMMENTS |
| date: | 02-09-17 | | | |
| scale: | 3/8" = 1" | | | |
| dr. by: | TARIQ | | | |
| chk. by: | | | | |
| drawing no. | 17-04 | | | |
| sheet | 7 of 7 | | | |